

17-1041
Contract
SP-1

DRAWING NUMBER

DRAWING NUMBER

DRAWING NUMBER

II. PIPE INSTALLATION

At the time that such closing or opening of the floor system becomes necessary, the Contractor shall notify the Engineer at least 48 hours in advance who will make the necessary arrangements to keep the shutdown time to a minimum. The Contractor shall keep the shutdown time to a minimum.

1. Concealed type piping shall be installed in a concealed manner. Concealed piping shall be installed in a concealed manner. Concealed piping shall be installed in a concealed manner.

2. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

3. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

4. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

5. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

6. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

7. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

8. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

9. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

10. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

11. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

12. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

13. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

14. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

15. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.


16. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

17. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.


18. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

19. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.


20. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner. Piping shall be installed in a concealed manner.

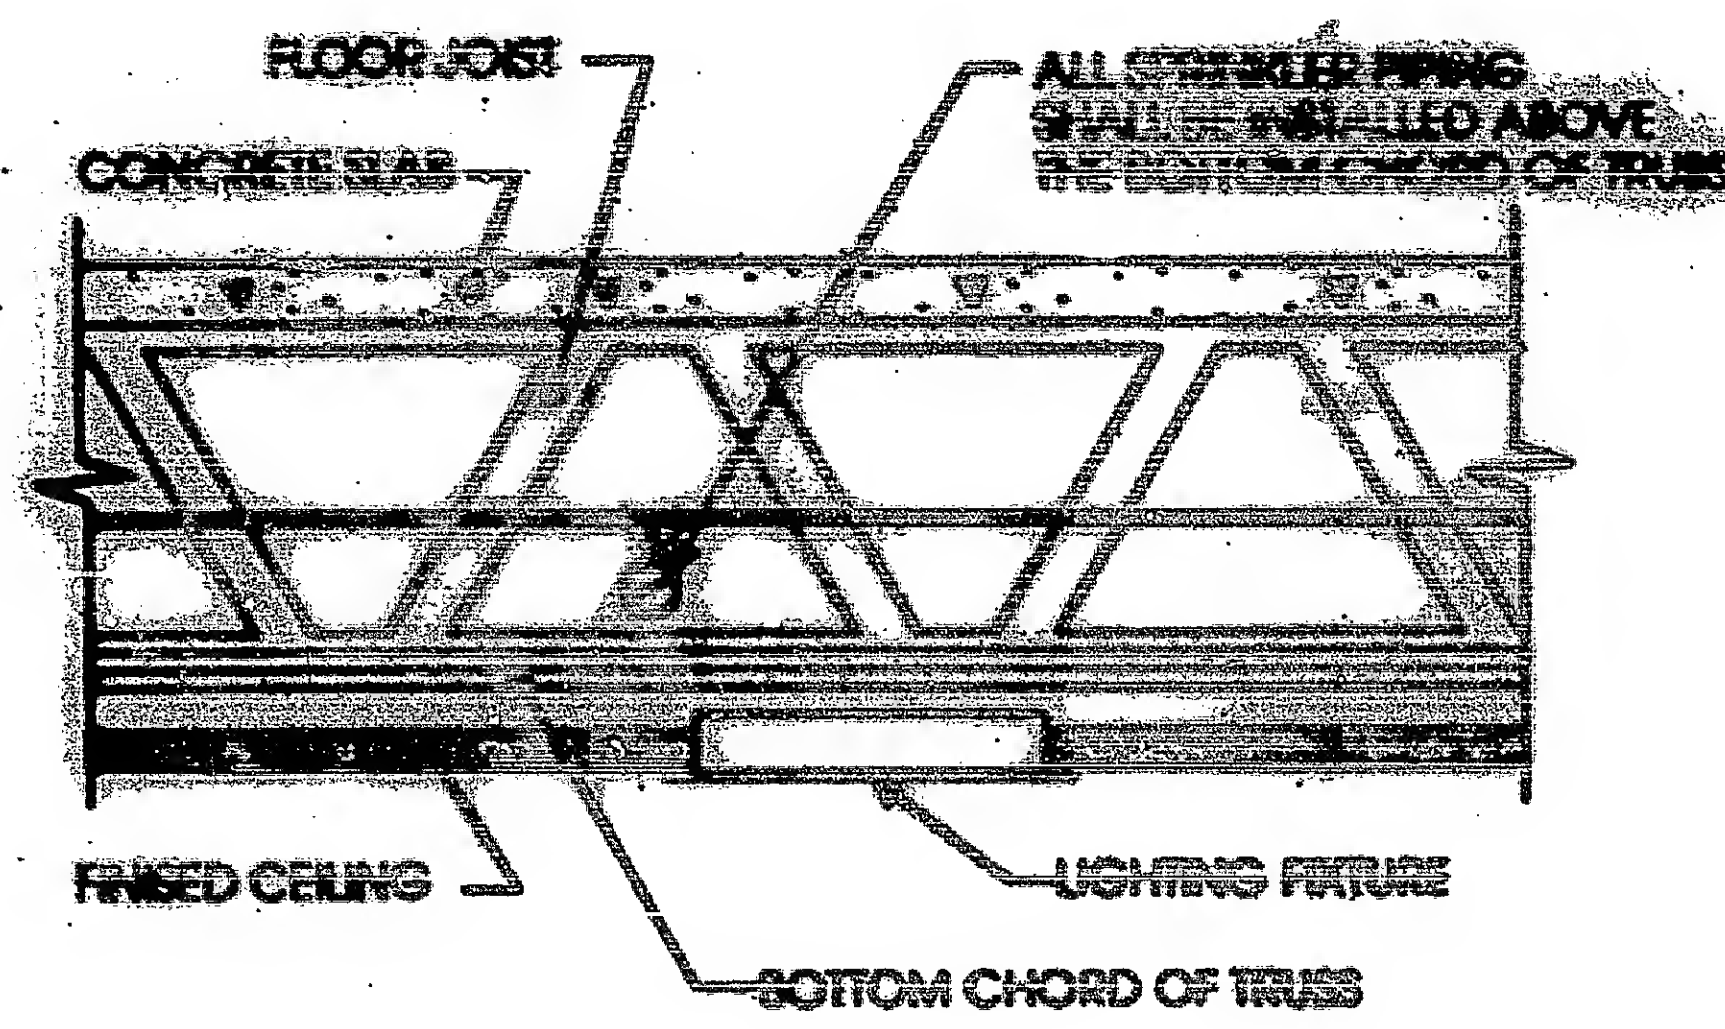

DETAIL OF LOCATION OF PIPE IN TRUSS SYSTEM
NOT TO SCALE

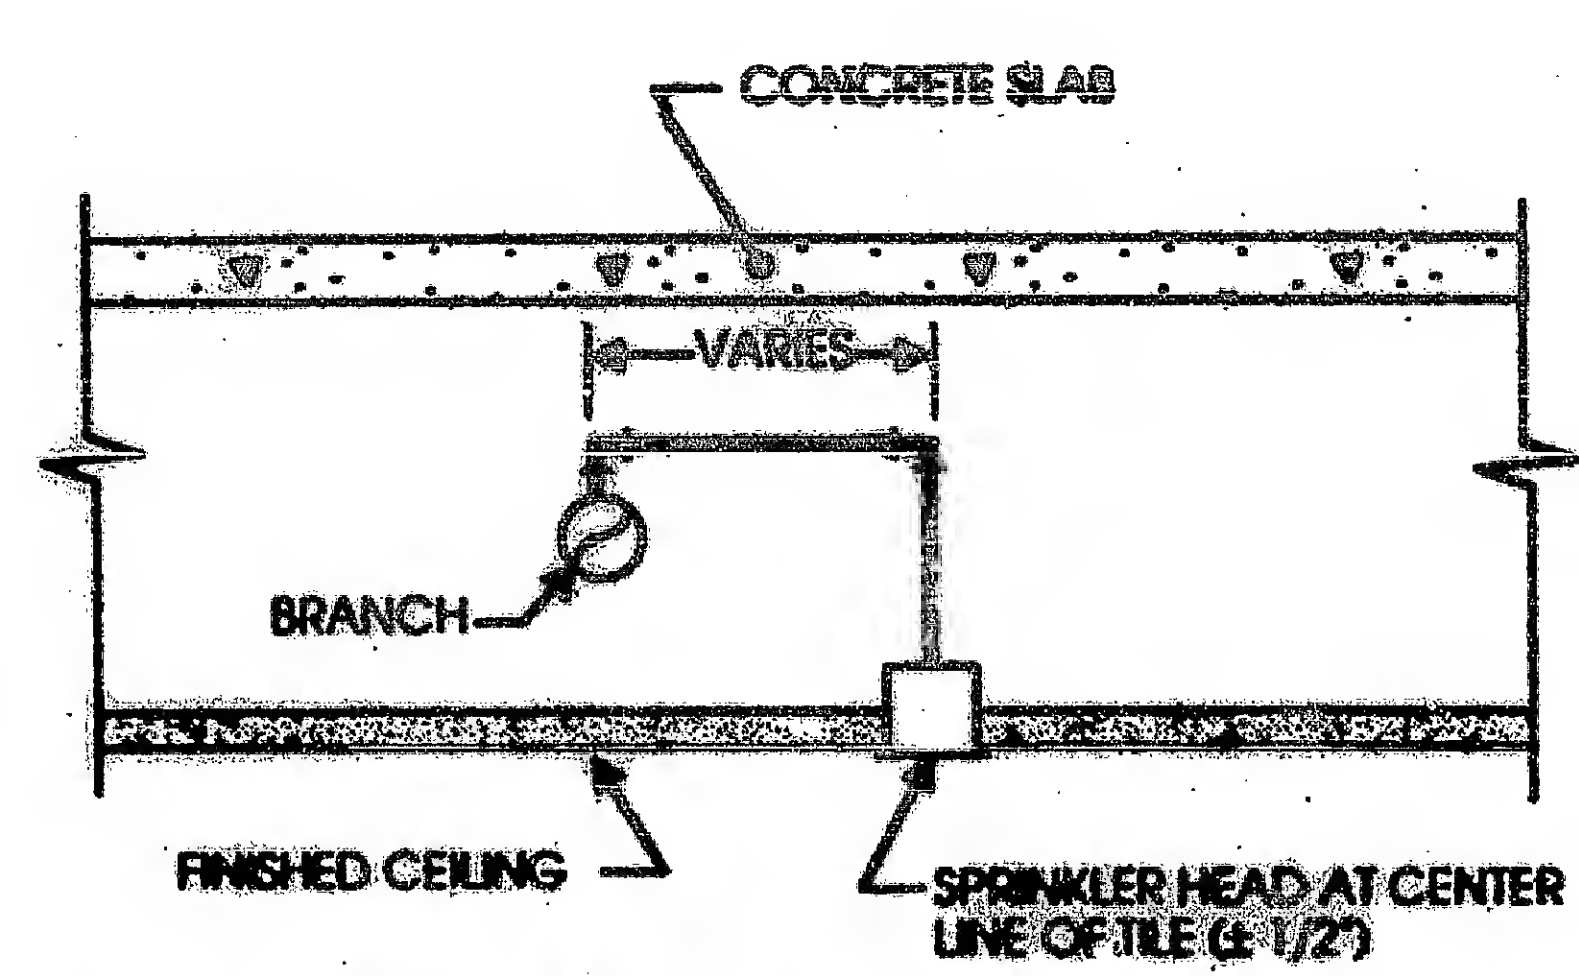

DETAIL OF TYPICAL PIPING CONNECTION TO SPRINKLER HEAD
NOT TO SCALE

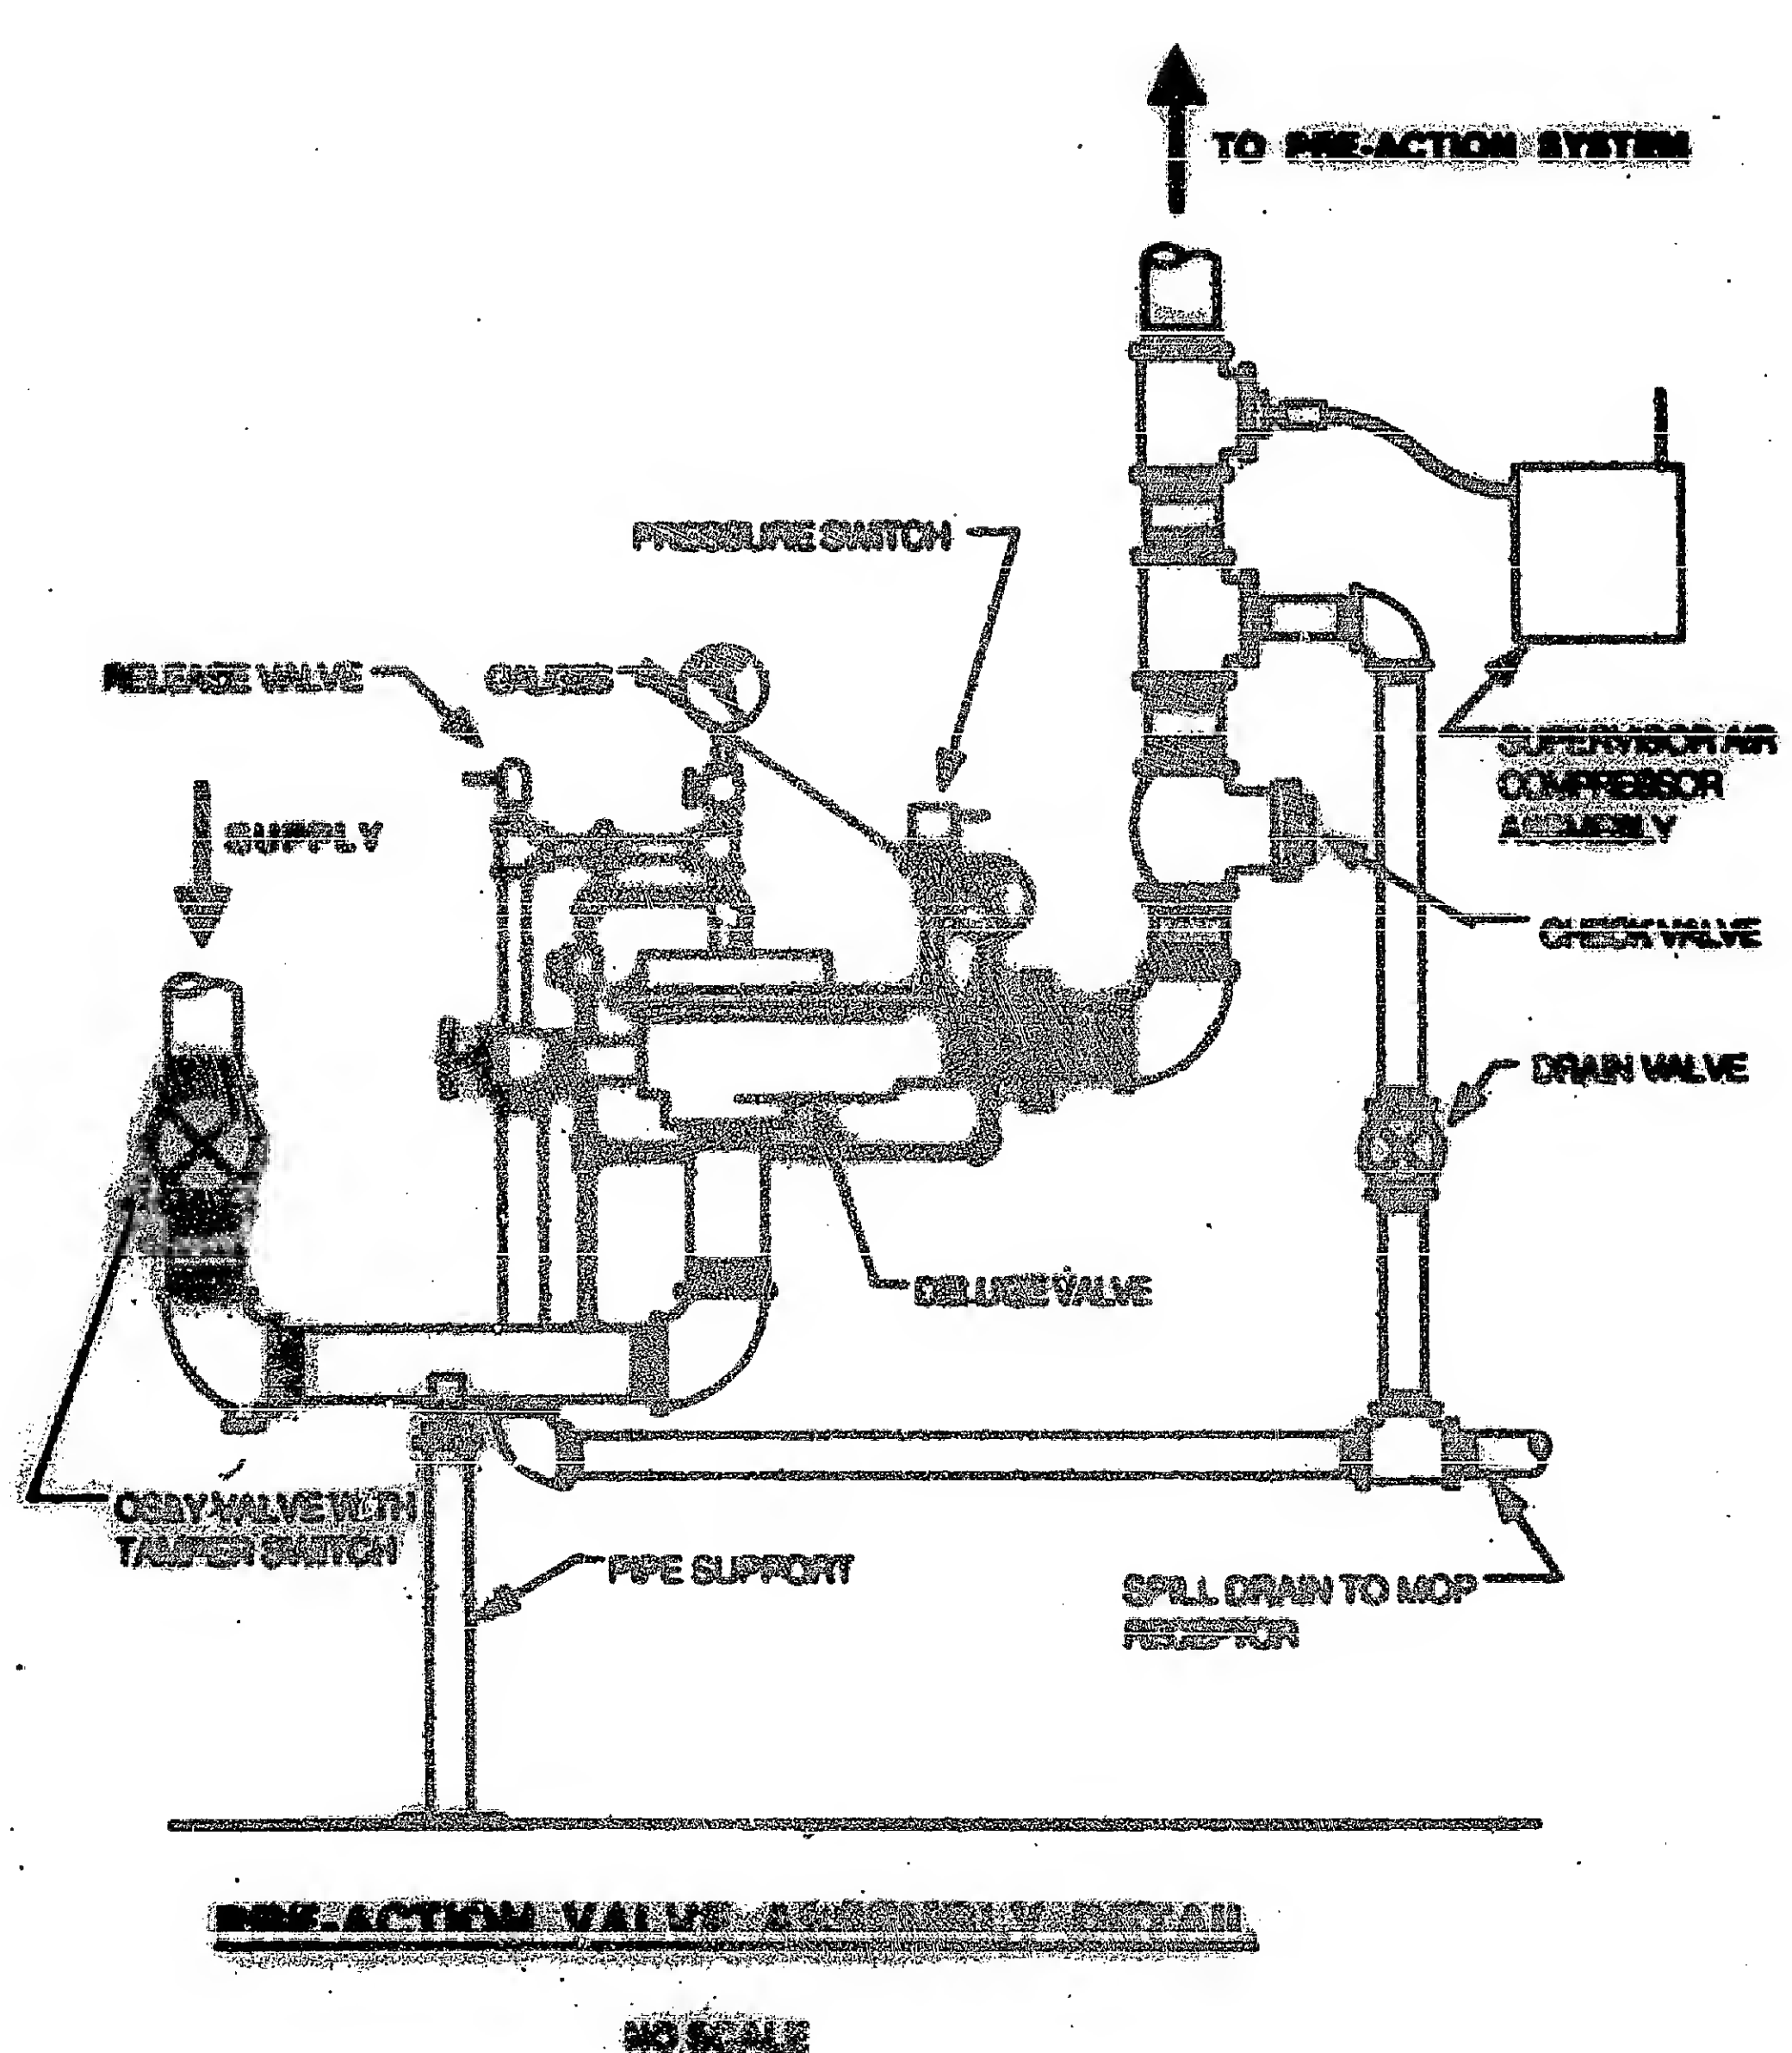

TERMINATE SLEEVE PLUMB WITH FINISH WALL SURFACE

1/2" CLEAR (MAX.)

TYPICAL